

QUICK REFERENCE DATA

*SA4BF SERIES RESIDENTIAL SPLIT SYSTEM AIR CONDITIONER

16 SEER

MODEL NUMBER: *SA4BF			024KC	036KB	048KC	060KC
ELECTRICAL DATA	Volts-Cycles-Phase (1)		208/230-60-1			
	Total Amps		12.3	16.5	23.7	31.4
	Delay Fuse Max. (2)		25	35	50	60
	Min. Circuit Ampacity		15.3	20.3	29.0	38.6
CONDENSER DATA	Coil	Area	13.3	20.3	22.8	25.4
		Rows-FPI	1-23	1-18	1-18	1-23
		Tube Dia	MC			
	Fan Motor	Type	PSC		BLDC	
		Amps	0.7	1.3	2.6	2.6
		HP	0.10	0.25	0.33	0.33
	Compressor Data	RLA	11.6	15.2	21.1	28.8
		LRA	58.3	83.0	104.0	152.9
REFRIGERANT SUCTION LINE O.D NOTE: Liquid line is 3/8" O.D. for entire length.		0-24 ft.	3/4"	3/4"	7/8"	7/8"
		25-39 ft.	7/8" (3)	7/8" (3)	1-1/8" (4)	1-1/8" (4)
		40-75 ft.	7/8" (3)	7/8" (3)	1-1/8" (4)	1-1/8" (4)
Refrigerant charge (R-410A) in ounces for outdoor unit, indoor unit and 15' line set. (5)			61.0	75.0	80.0	94.0
Approximate Weight (lbs.)		Net	144	188	208	223
		Ship	151	197	217	235

(1) Operating Voltage Range: 187v min. - 253v max.

(2) HACR Type Circuit Breakers may be used.

(3) Requires 7/8" to 3/4" reducer from line to unit.

(4) Requires 1-1/8" to 7/8" reducer from line to unit.

(5) Additional charge for line sets above 15 feet. Values based on suction line as follows with 3/8" liquid line.

(a) 3/4" = 0.6 oz. per additional foot.

(b) 7/8" = 0.7 oz. per additional foot.

(c) 1 1/8" = 0.8 oz. per additional foot.

NOTE: Cells with dashed lines indicate preliminary data.

Table 1. Electrical Specifications & Physical Data

WIRE GAUGE	RECOMMENDED MAXIMUM WIRE LENGTH (FT) FROM UNIT TO THERMOSTAT
22	45
20	70
18	115
16	180

Table 2. Thermostat Wire Gauge

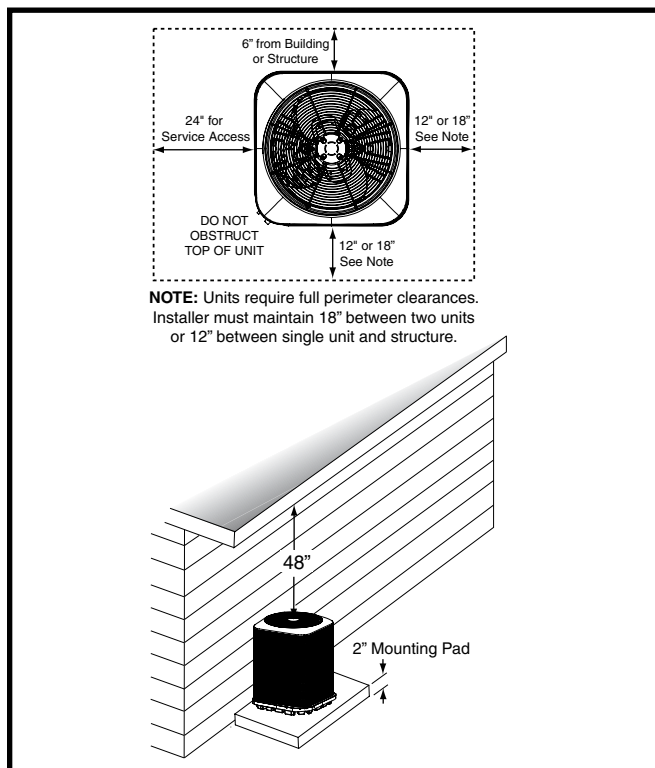


Figure 1. Clearance Requirements

Model PSA4BF Shown			
MODEL NUMBER	HEIGHT (H)	WIDTH (W)	DEPTH (D)
*SA4BF024KC	37 1/2"	22 3/4"	22 3/4"
*SA4BF036KB	37 1/2"	30 3/4"	30 3/4"
*SA4BF048KC	41 1/2"	30 3/4"	30 3/4"
*SA4BF060KC	45 1/2"	30 3/4"	30 3/4"

Table 3. Unit Dimensions

Instructions:

1. Find the column for the model of outdoor unit that is being installed.
2. Find the row for the model of the indoor unit that is being installed.
3. Find the cell in the table in which this row and column meet. In this cell the appropriate orifice / TXV and charge addition for this match are listed. If the text in this cell is BOLD, then a change of orifice is necessary.
4. If a change in restrictor is necessary, then the appropriate restrictor will already be supplied with the outdoor unit.

Examples:

- For the *SA4BF024KC / B6VMMX24K-B match, the appropriate TXV is the 669564 and no additional charge needs to be added. (NO CHANGES ARE NECESSARY)
- For the *SA4BF048KC / C7B(A,H)MX48(C,U)-C match, the appropriate TXV is the 669852 and no additional charge needs to be added. (NO CHANGES ARE NECESSARY).

ID Restrictor Installed With ID Unit	MODEL NUMBER: *SA4BF		024KC		036KB		048KC		060KB			
	OUTDOOR UNIT BOM CHARGE (OZ.)		61.0		75.0		80.0		94.0			
	MODELS		SUPPLIED WITH ID		REQUIRED RESTRICTOR OR TXV / CHARGE ADDITION (OZ) / RATED AIRFLOW (SCFM)							
	B6VM											
	B6VMAX36K-B		669566		--		669566 (5 / 1140)		--		--	
	B6VMAX48K-C		669568		--		--		669568 (21 / 1400)		--	
	B6VMAX60K-C		669578		--		--		--		669578 (23 / 1600)	
	C6											
	C6B(A,H)-X36(C,U)-B		669683		--		669683 (5 / 1145)		--		--	
	C6B(A,H)-X36(C,U)-C		669683		--		669683 (5 / 1145)		--		--	
	C6B(A,H)-X37(C,U)-C		669683		--		669683 (11 / 1145)		--		--	
	C6B(A,H)-X48(C,U)-C		669852		--		--		669852 (21 / 1415)		--	
	C6B(A,H)-X48(C,U)-D		669852		--		--		669852 (21 / 1415)		--	
	C6B(A,H)-X60(C,U)-C		669686		--		--		--		669686 (23 / 1575)	
	C6B(A,H)-X60(C,U)-D		669686		--		--		--		669686 (23 / 1575)	
	B6VMMX											
	B6VMMX24K-B		669564		669564 (0 / 880)		--		--		--	
	B6VMMX36K-B		669566		--		669566 (0 / 1170)		--		--	
	B6VMMX48K-C		669568		--		--		669568 (0 / 1400)		--	
	B6VMMX60K-C		669578		--		--		--		669578 (0 / 1695)	
	C7-X											
	C7B(A,H)MX24(C,U)-B		669681		669681 (0 / 875)		--		--		--	
	C7B(A,H)MX36(C,U)-B		669683		--		669683 (0 / 1170)		--		--	
	C7B(A,H)MX36(C,U)-C		669683		--		669683 (0 / 1170)		--		--	
	C7B(A,H)MX48(C,U)-C		669852		--		--		669852 (0 / 1415)		--	
	C7B(A,H)MX48(C,U)-D		669852		--		--		669852 (0 / 1415)		--	
	C7B(A,H)MX60(C,U)-C		669686		--		--		--		669686 (0 / 1695)	
	C7B(A,H)MX60(C,U)-D		669686		--		--		--		669686 (0 / 1585)	

NOTES:

- The charges listed are only valid for the standard 15' lineset.
- Part numbers beginning with 669***are TXV part numbers and numbers listed as 0.*** are restrictor diameters.

**Table 4. REQUIRED RESTRICTOR OR TXV
(CHARGE ADDITION (OZ) / RATED AIRFLOW -SCFM)**

