

INSTALLATION INSTRUCTIONS

AIR HANDLER CONTROL BOARD DRIP GUARD

IMPORTANT SAFETY INFORMATION

These instructions are primarily intended to assist qualified individuals experienced in the proper servicing of heating and air conditioning appliances. Some local codes require licensed installation / service personnel for this type equipment. Use of this kit must be in accordance with these instructions and with all applicable national and local codes and standards.

INSTALLER: Please read all instructions thoroughly before servicing this equipment. Pay attention to all safety warnings and any other special notes highlighted in the manual. Safety markings are used frequently throughout this manual to designate a degree or level of seriousness and should not be ignored. **WARNING** - Indicates a potentially hazardous situation that if not avoided, could result in personal injury or death.

WARNING:

ELECTRICAL SHOCK OR FIRE HAZARD

Failure to follow safety warnings exactly could result in serious injury or property damage.

Improper servicing could result in dangerous operation, serious injury, death or property damage.

- Before servicing, disconnect all electrical power to furnace.
- When servicing controls, label all wires prior to disconnecting. Reconnect wires correctly.
- Verify proper operation after servicing.

WARNING:

The safety information listed in this manual must be followed during the installation, service, and operation of this unit. Unqualified individuals should not attempt to interpret these instructions or install this equipment. Failure to follow safety recommendations could result in possible damage to the equipment, serious personal injury or death.

ABOUT THE DRIP GUARD

NOTE: This kit is to be used on air handlers that are in the horizontal right orientation while also being in an unconditioned humid environment. Its purpose is to protect the electric control board from any potential drops of condensate that could fall on it.

INSTALLATION SEQUENCE

1. **IMPORTANT!** Turn the power off to the unit.
2. Remove the top door from the air handler so the electric control board is visible
3. Loosen the screws securing the control board bracket.
NOTE: Do not remove them all of the way as the bracket is designed to slide under the screw heads.
4. Position the bracket in the air handler as shown in Figure 1. Verify the control board is covered and tighten the screws back down until bracket is secured in place.
5. Re-attach top door to the air handler and restore power to the unit.

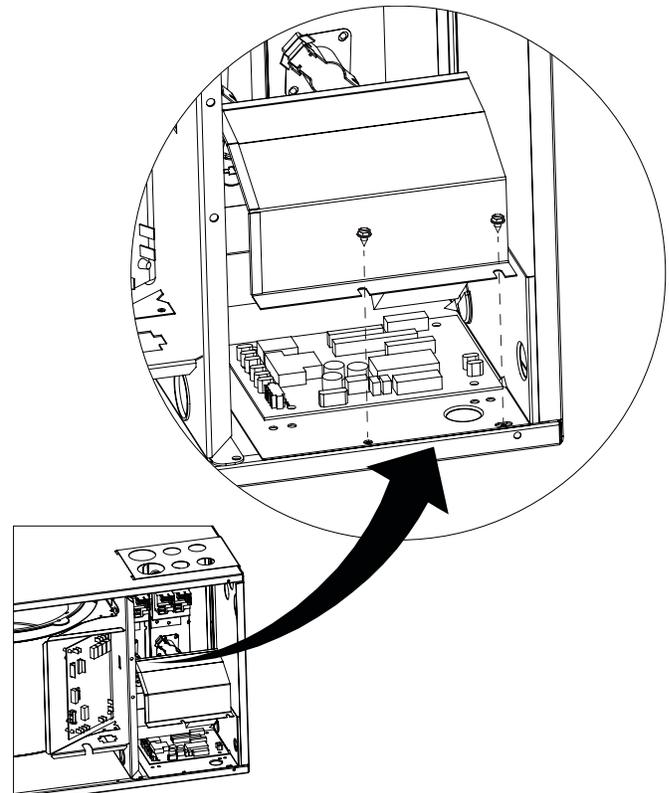


Figure 1. Installation of Drip Guard

