

QUICK REFERENCE DATA

*T4BE SERIES RESIDENTIAL SPLIT SYSTEM HEAT PUMP WITH MICROCHANNEL COILS

14 SEER

MODEL NUMBER: *T4BE			018KA	024KA	030KA	036KA	042KA	048KA	060KA
ELECTRICAL DATA	Volts-Cycles-Phase (1)		208/230-60-1						
	Total Amps		9.9	14.4	13.7	15.1	19.4	21.3	27.7
	Delay Fuse Max. (2)		20	30	25	30	40	45	60
	Min. Circuit Ampacity		12.1	17.7	16.9	18.6	23.9	26.3	34.3
CONDENSER DATA	Coil	Area	17.5	17.5	22.5	25.0	24.4	24.4	24.4
		Rows-FPI	1 - 14	1 - 14	1 - 14	1 - 14	1 - 14	1 - 14	1 - 16
		Tube Dia	MC						
	Fan Motor	Type	PSC						
		Amps	0.9	0.9	0.9	1.0	1.5	1.5	1.5
		HP	0.13	0.13	0.13	0.20	0.25	0.25	0.25
	Compressor Data	RLA	9.0	13.4	12.8	14.1	17.9	19.8	26.2
		LRA	46.0	58.3	64.0	77.0	112.0	109.0	134.0
Recommended Refrigerant suction line O.D* NOTE: Liquid line is 3/8" O.D. for entire length.		0-24 ft.	3/4"	3/4"	3/4"	7/8"	7/8"	7/8"	7/8"
		25-39 ft.	3/4"	3/4"	3/4"	7/8"	7/8"	7/8"	1-1/8" (3)
		40-75 ft.	3/4"	3/4"	3/4"	7/8"	7/8"	7/8"	1-1/8" (3)
REFRIGERANT CHARGE: R-410A in ounces for outdoor unit, indoor unit and 15' line set. (4)			96.0	93.0	97.0	98.0	115.0	115.0	114.0
Approximate Weight (lbs.)		Net	156	163	178	182	202	204	206
		Ship	165	172	187	191	211	213	215

- (1) Operating Voltage Range: 187v min. — 253v max.
 (2) HACR Type Circuit Breakers may be used.
 (3) Requires 7/8" to 3/4" reducer from line to unit.
 (4) Requires 7/8" to 1-1/8" reducer from line to unit.
 (5) Additional charge for line sets above 15 feet. Values based on suction line as follows with 3/8" liquid line.
 (a) 3/4" = 0.6 oz. per additional foot.
 (b) 7/8" = 0.7 oz. per additional foot.
 (c) 1 1/8" = 0.8 oz. per additional foot.
 * For other line set dimensions, refer to the Application Guidelines for Refrigerant Lines Addendum.

Table 1. Electrical Specifications & Physical Data

WIRE GAUGE	RECOMMENDED MAXIMUM WIRE LENGTH (FT) FROM UNIT TO THERMOSTAT
24	25
22	45
20	70
18	110

Table 2. Thermostat Wire

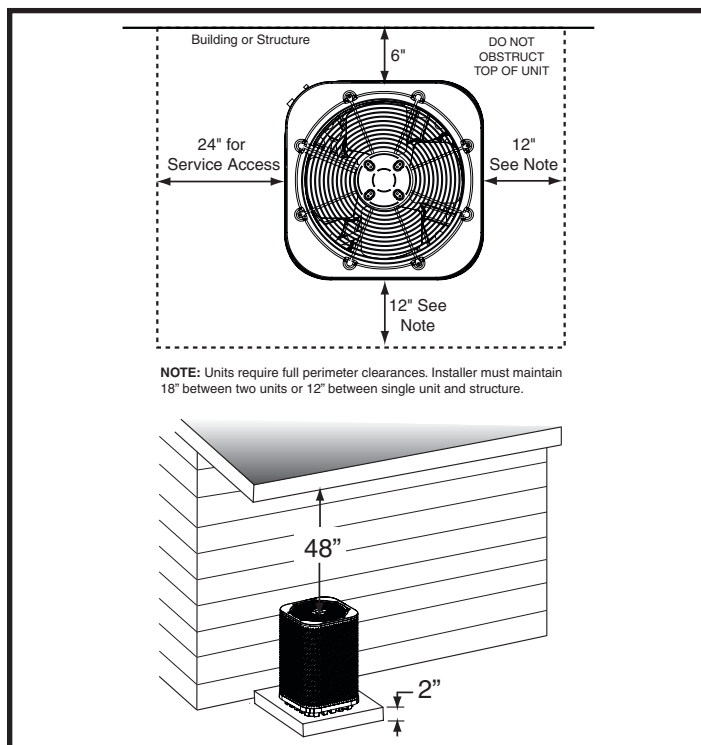


Figure 1. Clearance Requirements

Model JT4BE Shown			
MODEL NUMBER	HEIGHT (H)	WIDTH (W)	DEPTH (D)
*T4BE-018KA	31 1/2"	30 3/4"	30 3/4"
*T4BE-024KA	31 1/2"	30 3/4"	30 3/4"
*T4BE-030KA	39 1/2"	30 3/4"	30 3/4"
*T4BE-036KA	43 1/2"	30 3/4"	30 3/4"
*T4BE-042KA	43 1/2"	30 3/4"	30 3/4"
*T4BE-048KA	43 1/2"	30 3/4"	30 3/4"
*T4BE-060KA	43 1/2"	30 3/4"	30 3/4"

Table 3. Unit Dimensions

Instructions:

1. Find the column for the model of outdoor unit that is being installed.
2. Find the row for the model of the indoor unit that is being installed.
3. Find the cell in the table in which this row and column meet. In this cell the appropriate orifice / TXV and charge addition for this match are listed. If the text in this cell is BOLD, then a change of orifice is necessary.
4. If a change in restrictor is necessary, then the appropriate restrictor will already be supplied with the outdoor unit.

Examples:

- For the *T4BE-030KA / B6BMM030K-A match, the appropriate restrictor is the 0.062" and 25 ounces of refrigerant needs to be added (CHARGE ADDITION).
- For the *T4BE-060KA / B6BMM060K-C match, the indoor restrictor will need to be changed to the 0.091", the outdoor restrictor must be changed to the 0.074", and 3 ounces of refrigerant (CHANGE IN INDOOR RESTRICTOR, OUTDOOR RESTRICTOR, AND CHARGE ADDITION).

ID RESTRICTOR INSTALLED WITH ID UNIT	MODEL NUMBER: *T4BE		018KA	024KA	030KA	036KA	042KA	048KA	060KA
	ID RESTRICTOR SUPPLIED WITH OD UNIT:		0.050	0.057	0.061, 0.062	0.066	0.075	0.076	0.091
	OD RESTRICTOR INSTALLED IN OD UNIT:		0.040	0.041	0.048	0.055	0.059	0.062	0.076
	OUTDOOR UNIT BOM CHARGE (OZ.)		96	93	97	98	115	115	114
	MODELS	SUPPLIED WITH ID	REQUIRED RESTRICTOR OR TXV (CHARGE ADDITION (OZ) / RATED AIRFLOW (SCFM))						
	B6BMM0								
	B6BMM024K-A	0.055	0.050 (3 / 650)	0.057 (6 / 825)	--	--	--	--	--
	B6BMM024K-B	0.055	0.050 (3 / 650)	0.057 (6 / 825)	--	--	--	--	--
	B6BMM030K-A	0.062	--	--	0.062 (0 / 1040)	--	--	--	--
	B6BMM030K-B	0.062	--	--	0.062 (0 / 1040)	--	--	--	--
	B6BMM042K-B	0.074	--	--	--	0.067 (2 / 1195)	0.075 (5 / 1275)	--	--
	B6BMM060K-C	0.087	--	--	--	--	--	0.076 (4 / 1555)	0.091 (3 / 1615)
	B6BMMX								
	B6BMMX24K-A	669564	669564 (0 / 645)	669564 (0 / 840)	--	--	--	--	--
	B6BMMX24K-B	669564	669564 (0 / 645)	669564 (0 / 860)	--	--	--	--	--
	B6BMMX30K-A	669565	--	--	669565 (0 / 1040)	--	--	--	--
	B6BMMX30K-B	669565	--	--	669565 (0 / 1040)	--	--	--	--
	B6BMMX36K-B	669566	--	--	--	669566 (0 / 1250)	--	--	--
	B6BMMX48K-C	669568	--	--	--	--	669568 (3 / 1515)	--	--
	B6BMMX60K-C	669578	--	--	--	--	--	669578 (7 / 1510)	669578 (0 / 1600)
	B6BW								
	B6BW-018K(*)	0.048	--	--	--	--	--	--	--
	B6BW-024K(*)	0.057	--	0.057 (-7 / 805) ‡	--	--	--	--	--
	B6BW-030K(*)	0.060	--	--	0.061 (-25 / 1010) ‡	--	--	--	--
	B6BW-036K(*)	0.069	--	--	--	0.066 (-11 / 1145) ‡	--	--	--

NOTES:

- Gray cells require the outdoor restrictor to be changed as well. See Table 5.
- The charges listed are only valid for the standard 15' lineset.
- Part numbers beginning with 669***are TXV part numbers and numbers listed as 0.*** are restrictor diameters.
- ‡ Requires a REMOVAL of charge.

Table 4. Restrictor or TXV / Charge Addition (Oz)

THE CHARGE ADDITIONS PROVIDED IN THIS DOCUMENT ARE ESTIMATES BASED ON TEST DATA AND SHOULD ONLY BE A STARTING POINT. AFTER FOLLOWING THESE DIRECTIONS PLEASE ADJUST THE REFRIGERANT AMOUNT BASED ON THE APPROPRIATE CHARGING TABLES OR CHARTS IN THE INSTALLATION INSTRUCTIONS OR CHARGING LABEL.

ID RESTRICTOR INSTALLED WITH ID UNIT	MODEL NUMBER: *T4BE		018KA	024KA	030KA	036KA	042KA	048KA	060KA
	ID RESTRICTOR SUPPLIED WITH OD UNIT:		0.050	0.057	0.061, 0.062	0.066	0.075	0.076	0.091
	OD RESTRICTOR INSTALLED IN OD UNIT:		0.040	0.041	0.048	0.055	0.059	0.062	0.076
	OUTDOOR UNIT BOM CHARGE (OZ.)		96	93	97	98	115	115	114
	MODELS	SUPPLIED WITH ID	REQUIRED RESTRICTOR OR TXV (CHARGE ADDITION (OZ) / RATED AIRFLOW (SCFM))						
	B6EM								
	B6EMMX24K-A	669564	669564 (0 / 650)	669564 (0 / 820)	--	--	--	--	--
	B6EMMX24K-B	669564	669564 (0 / 650)	669564 (0 / 820)	--	--	--	--	--
	B6EMMX30K-A	669565	--	--	669565 (0 / 980)	--	--	--	--
	B6EMMX30K-B	669565	--	--	669565 (0 / 980)	--	--	--	--
	B6EMMX36K-B	669566	--	--	--	669566 (12 / 1140)	--	--	--
	B6EMMX42K-B	669567	--	--	--	--	669567 (11 / 1205)	--	--
	B6EMMX48K-C	669852	--	--	--	--	--	669852 (7 / 1510)	--
	B6EMMX60K-C	669578	--	--	--	--	--	--	669578 (0 / 1600)
	B6EW								
	B6EW-X18K	669564	669564 (-9 / 650) ‡	--	--	--	--	--	--
	B6EW-X25K	669564	--	669564 (-14 / 865) ‡	--	--	--	--	--
	B6EW-X30K	669565	--	--	669565 (-20 / 1000) ‡	--	--	--	--
	B6EW-X36K	669566	--	--	--	669566 (-11 / 1100) ‡	--	--	--
	B6VMMX								
	B6VMMX24K-A	669564	669564 (0 / 650)	669564 (0 / 820)	--	--	--	--	--
	B6VMMX24K-B	669564	669564 (0 / 650)	669564 (0 / 820)	--	--	--	--	--
	B6VMMX30K-A	669565	--	--	669565 (0 / 980)	--	--	--	--
	B6VMMX30K-B	669565	--	--	669565 (0 / 980)	--	--	--	--
	B6VMMX36K-B	669566	--	--	--	669566 (0 / 1140)	--	--	--
	B6VMMX42K-B	669567	--	--	--	--	669567 (11 / 1205)	--	--
	B6VMMX48K-C	669568	--	--	--	--	--	669568 (7 / 1510)	--
	B6VMMX60K-C	669578	--	--	--	--	--	--	669578 (0 / 1600)

NOTES:

- Gray cells require the outdoor restrictor to be changed as well. See Table 5.
- The charges listed are only valid for the standard 15' lineset.
- Part numbers beginning with 669*** are TXV part numbers and numbers listed as 0.*** are restrictor diameters.
- ‡ Requires a **REMOVAL** of charge.

Table 4. Restrictor or TXV / Charge Addition (Oz) - Continued

THE CHARGE ADDITIONS PROVIDED IN THIS DOCUMENT ARE ESTIMATES BASED ON TEST DATA AND SHOULD ONLY BE A STARTING POINT. AFTER FOLLOWING THESE DIRECTIONS PLEASE ADJUST THE REFRIGERANT AMOUNT BASED ON THE APPROPRIATE CHARGING TABLES OR CHARTS IN THE INSTALLATION INSTRUCTIONS OR CHARGING LABEL.

Instructions:

1. Find the column for the model of outdoor unit that is being installed.
2. Find the row for the model of the indoor unit that is being installed.
3. Find the cell in the table in which this row and column meet. In this cell the appropriate orifice / TXV and charge addition for this match are listed. If the text in this cell is BOLD, then a change of orifice is necessary.
4. If a change in restrictor is necessary, then the appropriate restrictor will already be supplied with the outdoor unit.

Examples:

- For the *T4BE-030KA / B6BMM030K-A match, the appropriate restrictor is the 0.062" and 25 ounces of refrigerant needs to be added (CHARGE ADDITION).
- For the *T4BE-060KA / B6BMM060K-C match, the indoor restrictor will need to be changed to the 0.091", the outdoor restrictor must be changed to the 0.074", and 3 ounces of refrigerant (CHANGE IN INDOOR RESTRICTOR, OUTDOOR RESTRICTOR, AND CHARGE ADDITION).

ID RESTRICTOR INSTALLED WITH ID UNIT	MODEL NUMBER: *T4BE		018KA	024KA	030KA	036KA	042KA	048KA	060KA	
	ID RESTRICTOR SUPPLIED WITH OD UNIT:		0.050	0.057	0.061, 0.062	0.066	0.075	0.076	0.091	
	OD RESTRICTOR INSTALLED IN OD UNIT:		0.040	0.041	0.048	0.055	0.059	0.062	0.076	
	OUTDOOR UNIT BOM CHARGE (OZ.)		96	93	97	98	115	115	114	
	MODELS		SUPPLIED WITH ID	REQUIRED RESTRICTOR OR TXV (CHARGE ADDITION (OZ) / RATED AIRFLOW (SCFM))						
	C7-0									
	C7B(A,H)M030(C,U)-C	0.061	--	--	0.062 (0 / 1040)	--	--	--	--	
	C7B(A,H)M03036(C,U)-A	0.061	--	--	0.062 (0 / 1040)	--	--	--	--	
	C7B(A,H)M03036(C,U)-B	0.067	--	--	0.062 (0 / 1040)	--	--	--	--	
	C7B(A,H)M03642(C,U)-B	0.071	--	--	--	0.067 (2 / 1195)	0.075 (5 / 1275)	--	--	
	C7B(A,H)M03648(C,U)-C	0.067	--	--	--	0.067 (2 / 1195)	0.075 (5 / 1275)	--	--	
	C7B(A,H)M042(C,U)-D	0.071	--	--	--	--	0.075 (5 / 1275)	--	--	
	C7-0 + TXV									
	C7B(A,H)M01824(C,U)-A + TXV	0.048	920668A (0 / 650)	920668A (0 / 820)	--	--	--	--	--	
	C7B(A,H)M01824(C,U)-B + TXV	0.055	920668A (0 / 660)	920668A (0 / 820)	--	--	--	--	--	
	C7B(A,H)M030(C,U)-C + TXV	0.061	--	920668A (0 / 820)	920669A (0 / 980)	--	--	--	--	
	C7B(A,H)M03036(C,U)-A + TXV	0.061	--	--	920669A (0 / 980)	--	--	--	--	
	C7B(A,H)M03036(C,U)-B + TXV	0.067	--	--	920669A (0 / 980)	--	--	--	--	
	C7B(A,H)M03642(C,U)-B + TXV	0.071	--	--	--	920670A (11 / 1140)	920671A (13 / 1275)	--	--	
	C7B(A,H)M03648(C,U)-C + TXV	0.067	--	--	--	920670A (11 / 1140)	920671A (13 / 1275)	--	--	
	C7B(A,H)M042(C,U)-D + TXV	0.071	--	--	--	--	920671A (13 / 1275)	--	--	
	C7B(A,H)M048(C,U)-C + TXV	0.077	--	--	--	--	--	920672A (7 / 1510)	--	
	C7B(A,H)M048(C,U)-D + TXV	0.077	--	--	--	--	--	920672A (7 / 1510)	--	
	C7B(A,H)M060(C,U)-C + TXV	0.083	--	--	--	--	--	--	920673A (0 / 1600)	

NOTES:

- Gray cells require the outdoor restrictor to be changed as well. See Table 5.
- The charges listed are only valid for the standard 15' lineset.
- Part numbers beginning with 669***are TXV part numbers and numbers listed as 0.*** are restrictor diameters.
- ‡ Requires a REMOVAL of charge.

Table 4. Restrictor or TXV / Charge Addition (Oz) - Continued

THE CHARGE ADDITIONS PROVIDED IN THIS DOCUMENT ARE ESTIMATES BASED ON TEST DATA AND SHOULD ONLY BE A STARTING POINT. AFTER FOLLOWING THESE DIRECTIONS PLEASE ADJUST THE REFRIGERANT AMOUNT BASED ON THE APPROPRIATE CHARGING TABLES OR CHARTS IN THE INSTALLATION INSTRUCTIONS OR CHARGING LABEL.

Instructions:

1. Find the column for the model of outdoor unit that is being installed.
2. Find the row for the model of the indoor unit that is being installed.
3. Find the cell in the table in which this row and column meet. In this cell the appropriate orifice / TXV and charge addition for this match are listed. If the text in this cell is BOLD, then a change of orifice is necessary.
4. If a change in restrictor is necessary, then the appropriate restrictor will already be supplied with the outdoor unit.

Examples:

- For the *T4BE-030KA / B6BMM030K-A match, the appropriate restrictor is the 0.062" and 25 ounces of refrigerant needs to be added (CHARGE ADDITION).
- For the *T4BE-060KA / B6BMM060K-C match, the indoor restrictor will need to be changed to the 0.091", the outdoor restrictor must be changed to the 0.074", and 3 ounces of refrigerant (CHANGE IN INDOOR RESTRICTOR, OUTDOOR RESTRICTOR, AND CHARGE ADDITION).

ID RESTRICTOR INSTALLED WITH ID UNIT	MODEL NUMBER: *T4BE		018KA	024KA	030KA	036KA	042KA	048KA	060KA
	ID RESTRICTOR SUPPLIED WITH OD UNIT:		0.050	0.057	0.061, 0.062	0.066	0.075	0.076	0.091
	OD RESTRICTOR INSTALLED IN OD UNIT:		0.040	0.041	0.048	0.055	0.059	0.062	0.076
	OUTDOOR UNIT BOM CHARGE (OZ.)		96	93	97	98	115	115	114
	MODELS	SUPPLIED WITH ID	REQUIRED RESTRICTOR OR TXV (CHARGE ADDITION (OZ) / RATED AIRFLOW (SCFM))						
	C7-X								
	C7B(A,H)MX24(C,U)-A	669681	669681 (0 / 660)	669681 (0 / 810)	--	--	--	--	--
	C7B(A,H)MX24(C,U)-B	669681	669681 (0 / 660)	669681 (0 / 810)	--	--	--	--	--
	C7B(A,H)MX30(C,U)-A	669682	--	--	669682 (0 / 980)	--	--	--	--
	C7B(A,H)MX30(C,U)-B	669682	--	--	669682 (0 / 980)	--	--	--	--
	C7B(A,H)MX30(C,U)-C	669682	--	669682 (0 / 810)	669682 (0 / 980)	--	--	--	--
	C7B(A,H)MX36(C,U)-B	669683	--	--	--	669683 (11 / 1140)	--	--	--
	C7B(A,H)MX36(C,U)-C	669683	--	--	--	669683 (11 / 1140)	--	--	--
	C7B(A,H)MX42(C,U)-C	669684	--	--	--	--	669684 (13 / 1205)	--	--
	C7B(A,H)MX48(C,U)-C	669852	--	--	--	--	--	669852 (7 / 1510)	--
	C7B(A,H)MX48(C,U)-D	669852	--	--	--	--	--	669852 (7 / 1510)	--
	C7B(A,H)MX60(C,U)-C	669686	--	--	--	--	--	--	669686 (0 / 1545)
	C8-0 (WHEN MATCHED WITH ET4BE OR JT4BE FOR MANUFACTURED HOUSING APPLICATIONS)								
	C8(B,D)AM01830U-B	0.061	920668A (0 / 660)	920668A (0 / 820)	920669A (0 / 980)	--	--	--	--
	C8(B,D)AM036U-B	0.067	--	--	--	920670A (7 / 1200)	--	--	--
C8-X (WHEN MATCHED WITH ET4BE OR JT4BE FOR MANUFACTURED HOUSING APPLICATIONS)									
C8(B,D)AMX24U-B	669564	669564 (0 / 660)	669564 (0 / 810)	--	--	--	--	--	
C8(B,D)AMX30U-B	669565	--	--	669565 (0 / 980)	--	--	--	--	
C8(B,D)AMX36U-B	669566	--	--	--	669566 (6 / 1200)	--	--	--	
C8(B,D)AMX42U-B	669567	--	--	--	--	669567 (5 / 1355)	--	--	
C8(B,D)AMX49U-B	669568	--	--	--	--	--	669568 (2 / 1500)	--	

NOTES:

- Gray cells require the outdoor restrictor to be changed as well. See Table 5.
- The charges listed are only valid for the standard 15' lineset.
- Part numbers beginning with 669***are TXV part numbers and numbers listed as 0.*** are restrictor diameters.
- Bold part numbers beginning with a 9 are TXV kit numbers and must be ordered separately.
- ‡ Requires a REMOVAL of charge.

Table 4. Restrictor or TXV / Charge Addition (Oz) - Continued

THE CHARGE ADDITIONS PROVIDED IN THIS DOCUMENT ARE ESTIMATES BASED ON TEST DATA AND SHOULD ONLY BE A STARTING POINT. AFTER FOLLOWING THESE DIRECTIONS PLEASE ADJUST THE REFRIGERANT AMOUNT BASED ON THE APPROPRIATE CHARGING TABLES OR CHARTS IN THE INSTALLATION INSTRUCTIONS OR CHARGING LABEL.

OD UNIT	ID UNIT	FACTORY INSTALLED RESTRICTOR	CORRECT OUTDOOR RESTRICTOR
*T4BE-018KA	B6BMM024K-A	0.040	0.039
	B6BMM024K-B		0.039
	B6EW-X18K		0.044
	C7B(A,H)M01824(C,U)-A + TXV		0.039
	C7B(A,H)M01824(C,U)-B + TXV		0.039
	C7B(A,H)MX24(C,U)-A		0.039
	C7B(A,H)MX24(C,U)-B		0.039
	C8(B,D)AM01830U-B		0.039
	C8(B,D)AMX24U-B		0.039
T4BE-024KA	B6BW-024K()	0.041	0.047
	B6EW-X25K		0.049
	C7B(A,H)M01824(C,U)-A + TXV		0.042
	C7B(A,H)M01824(C,U)-B + TXV		0.042
	C7B(A,H)M030(C,U)-C + TXV		0.042
	C7B(A,H)MX24(C,U)-A		0.042
	C7B(A,H)MX24(C,U)-B		0.042
	C7B(A,H)MX30(C,U)-C		0.042
	C8(B,D)AM01830U-B		0.042
	C8(B,D)AMX24U-B		0.042
T4BE-030KA	B6BW-030K()	0.048	0.051
	B6EW-X30K		0.053
	C7B(A,H)M030(C,U)-C + TXV		0.051
	C7B(A,H)M03036(C,U)-A + TXV		0.051
	C7B(A,H)M03036(C,U)-B + TXV		0.051
	C7B(A,H)MX30(C,U)-A		0.051
	C7B(A,H)MX30(C,U)-B		0.051
	C7B(A,H)MX30(C,U)-C		0.051
	C8(B,D)AM01830U-B		0.051
	C8(B,D)AMX30U-B		0.051
*T4BE-036KA	B6BMM042K-B	0.055	0.056
	B6BW-036K(*)		0.059
	B6EW-X36K		0.059
	C7B(A,H)M03642(C,U)-B		0.056
	C7B(A,H)M03648(C,U)-C		0.056
*T4BE-042KA	C8(B,D)AMX42U-B	0.059	0.057
*T4BE-048KA	B6BMM060K-C	0.062	0.059
	C8(B,D)AMX49U-B	0.062	0.060
*T4BE-060KA	B6BMM060K-C	0.076	0.074

Table 5. Outdoor Restrictor Changes

THE CHARGE ADDITIONS PROVIDED IN THIS DOCUMENT ARE ESTIMATES BASED ON TEST DATA AND SHOULD ONLY BE A STARTING POINT. AFTER FOLLOWING THESE DIRECTIONS PLEASE ADJUST THE REFRIGERANT AMOUNT BASED ON THE APPROPRIATE CHARGING TABLES OR CHARTS IN THE INSTALLATION INSTRUCTIONS OR CHARGING LABEL.

