

QUICK REFERENCE DATA

PSA4BG Series Residential Split System Air Conditioner

20 SEER

MODEL NUMBER:			PSA4BG024K	PSA4BG036K	PSA4BG048K	PSA4BG060K
ELECTRICAL DATA	Volts-Cycles-Phase ⁽¹⁾		208/230-60-1			
	Total Amps		11.9	17.3	18.9	28.8
	Delay Fuse Max. ⁽²⁾		20	35	35	60
	Min. Circuit Ampacity		14.2	21	23	35.1
	Field Control Wiring Connections (24 vac from thermostat/indoor side)		R, C, Y1, Y2			
CONDENSER DATA	Coil	Area (ft²)	13.3	20.4	24.8	24.8
		Rows - FPI	1-23	1-18	1-23	1-23
		Tube	MC	MC	MC	MC
	Fan Motor	Type	Brushless DC			
		Amps	2.6	2.6	2.6	3.8
		HP	1/3	1/3	1/3	1/2
	Compressor Data	RLA	9.3	14.7	16.3	25
		LRA	N/A	N/A	N/A	N/A
	Service Valves	Liquid Side	3/8"	3/8"	3/8"	3/8"
		Vapor Side	3/4"	7/8"	7/8"	7/8"
Installation Refrigerant Vapor Line Size (All liquid lines 3/8" OD)		0 - 24 ft. equiv.	3/4"	7/8"	7/8"	7/8"
		25 - 39 ft. equiv.	3/4"	7/8"	1-1/8"	1-1/8"
		40 - 75 ft. equiv.	7/8"	1-1/8"	1-1/8"	1-1/8"
		75 - 100 ft. equiv.	1-1/8"	1-1/8"	1-1/8"	1-1/8"
Refrigerant Type			R-410A			
Refrigerant Charge (oz.), 15 ft. line set (factory charge)			78 ⁽³⁾	93 ⁽³⁾	110 ⁽³⁾	123 ⁽³⁾
Weight Approximate (lbs.)		As shipped	149	197	225	240
		Net	136	178	205	220

(1) Operating Voltage Range: 187v min. — 253v max.

(2) HACR Type Circuit Breakers may be used.

(3) Additional charge required for line sets above 15 feet. Values based on vapor line as follows with 3/8" liquid line.

(a) 3/4" = 0.6 oz. per additional foot.

(b) 7/8" = 0.7 oz. per additional foot.

(c) 1 1/8" = 0.8 oz. per additional foot.

Table 1. Electrical Specifications & Physical Data

WIRE GAUGE	RECOMMENDED MAXIMUM WIRE LENGTH (FT) FROM UNIT TO THERMOSTAT
22	45
20	70
18	115
16	180

Table 2. Control Wiring (24V)

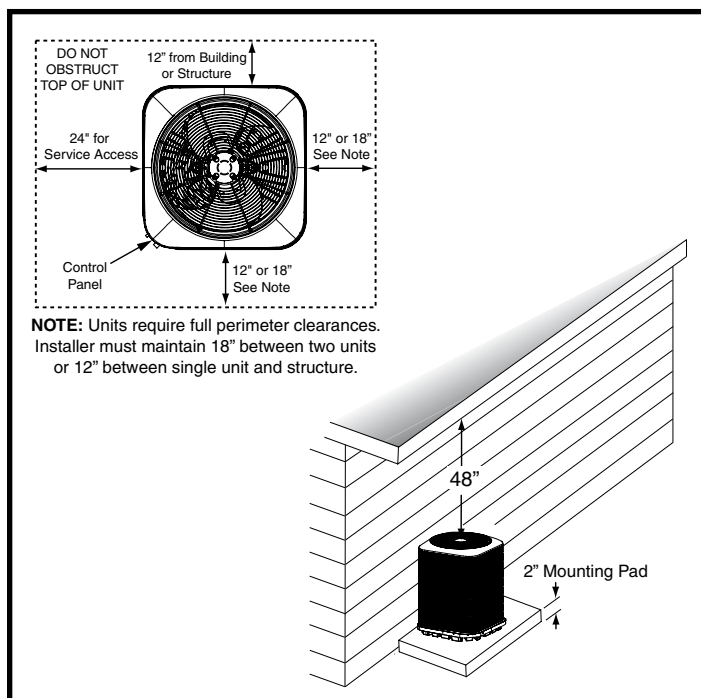


Figure 1. Clearance Requirements

MODEL NUMBER	HEIGHT (H)	WIDTH (W)	DEPTH (D)
PSA4BG024K	37"	22 1/2"	22 1/2"
PSA4BG036K	37"	30 1/2"	30 1/2"
PSA4BG048K	45"	30 1/2"	30 1/2"
PSA4BG060K	45"	30 1/2"	30 1/2"

Table 3. Unit Dimensions

Instructions:

1. Find the column for the model of outdoor unit that is being installed.
2. Find the row for the model of the indoor unit that is being installed.
3. Find the cell in the table in which this row and column meet. In this cell the appropriate TXV and charge addition for this match are listed.

TXV INSTALLED WITH INDOOR COIL	MODEL NUMBER:		PSA4BG024K	PSA4BG036K	PSA4BG048K	PSA4BG060K
	OUTDOOR UNIT FACTORY CHARGE (OZ.):		78	93	110	123
	MODELS	INDOOR COIL TXV (AS-BUILT)	REQUIRED INDOOR TXV OR TXV KIT CHARGE ADDITION (OZ) / RATED CFM (4)			
	B6EM					
	B6EMMX24K-B	669564	TXV as-built (0 / 810)	--	--	--
	B6EMMX36K-B	669566	--	TXV as-built (0 / 1050)	--	--
	B6EMMX48K-C	669568	--	--	TXV as-built (0 / 1480)	--
	B6EMMX60K-C	669578	--	--	--	TXV as-built (0 / 1675)
	C7BH					
	C7BHMx-24C-B	669681	TXV as-built (0 / 810)	--	--	--
	C7BHMx-36C-B	669683	--	TXV as-built (0 / 1050)	--	--
	C7BHMx-36C-C	669683	--	TXV as-built (0 / 1050)	--	--
	C7BHMx-48C-C	669852	--	--	TXV as-built (0 / 1480)	--
	C7BHMx-48C-D	669852	--	--	TXV as-built (0 / 1480)	--
	C7BHMx-60C-C	669686	--	--	--	TXV as-built (0 / 1675)
C7BHMx-60C-D	669686	--	--	--	TXV as-built (0 / 1675)	

NOTES

⁽⁴⁾ Charge addition is for coil change only. For line sets longer than 15 feet see Installation Instructions.

CFM refers to blower flow at rating point. Refer to indoor unit air flow setting information in the Installation Instructions for that unit.

Table 4. TXV / Charge Addition (Oz)

NORDYNE
COMPLETE COMFORT. GENUINE VALUE.

Specifications & illustrations subject to change
without notice or incurring obligations (10/14).



7096620 (NEW)