


WIRING DIAGRAM

For 97+ Modulating Gas Furnaces

Refer to the Installation Instructions provided with the kit for the proper heating and cooling speeds for your application.

If any of the original wire as supplied with the furnace must be replaced, it must be replaced with wiring material having a temperature rating of at least 105 degrees C.

Use copper conductors only.

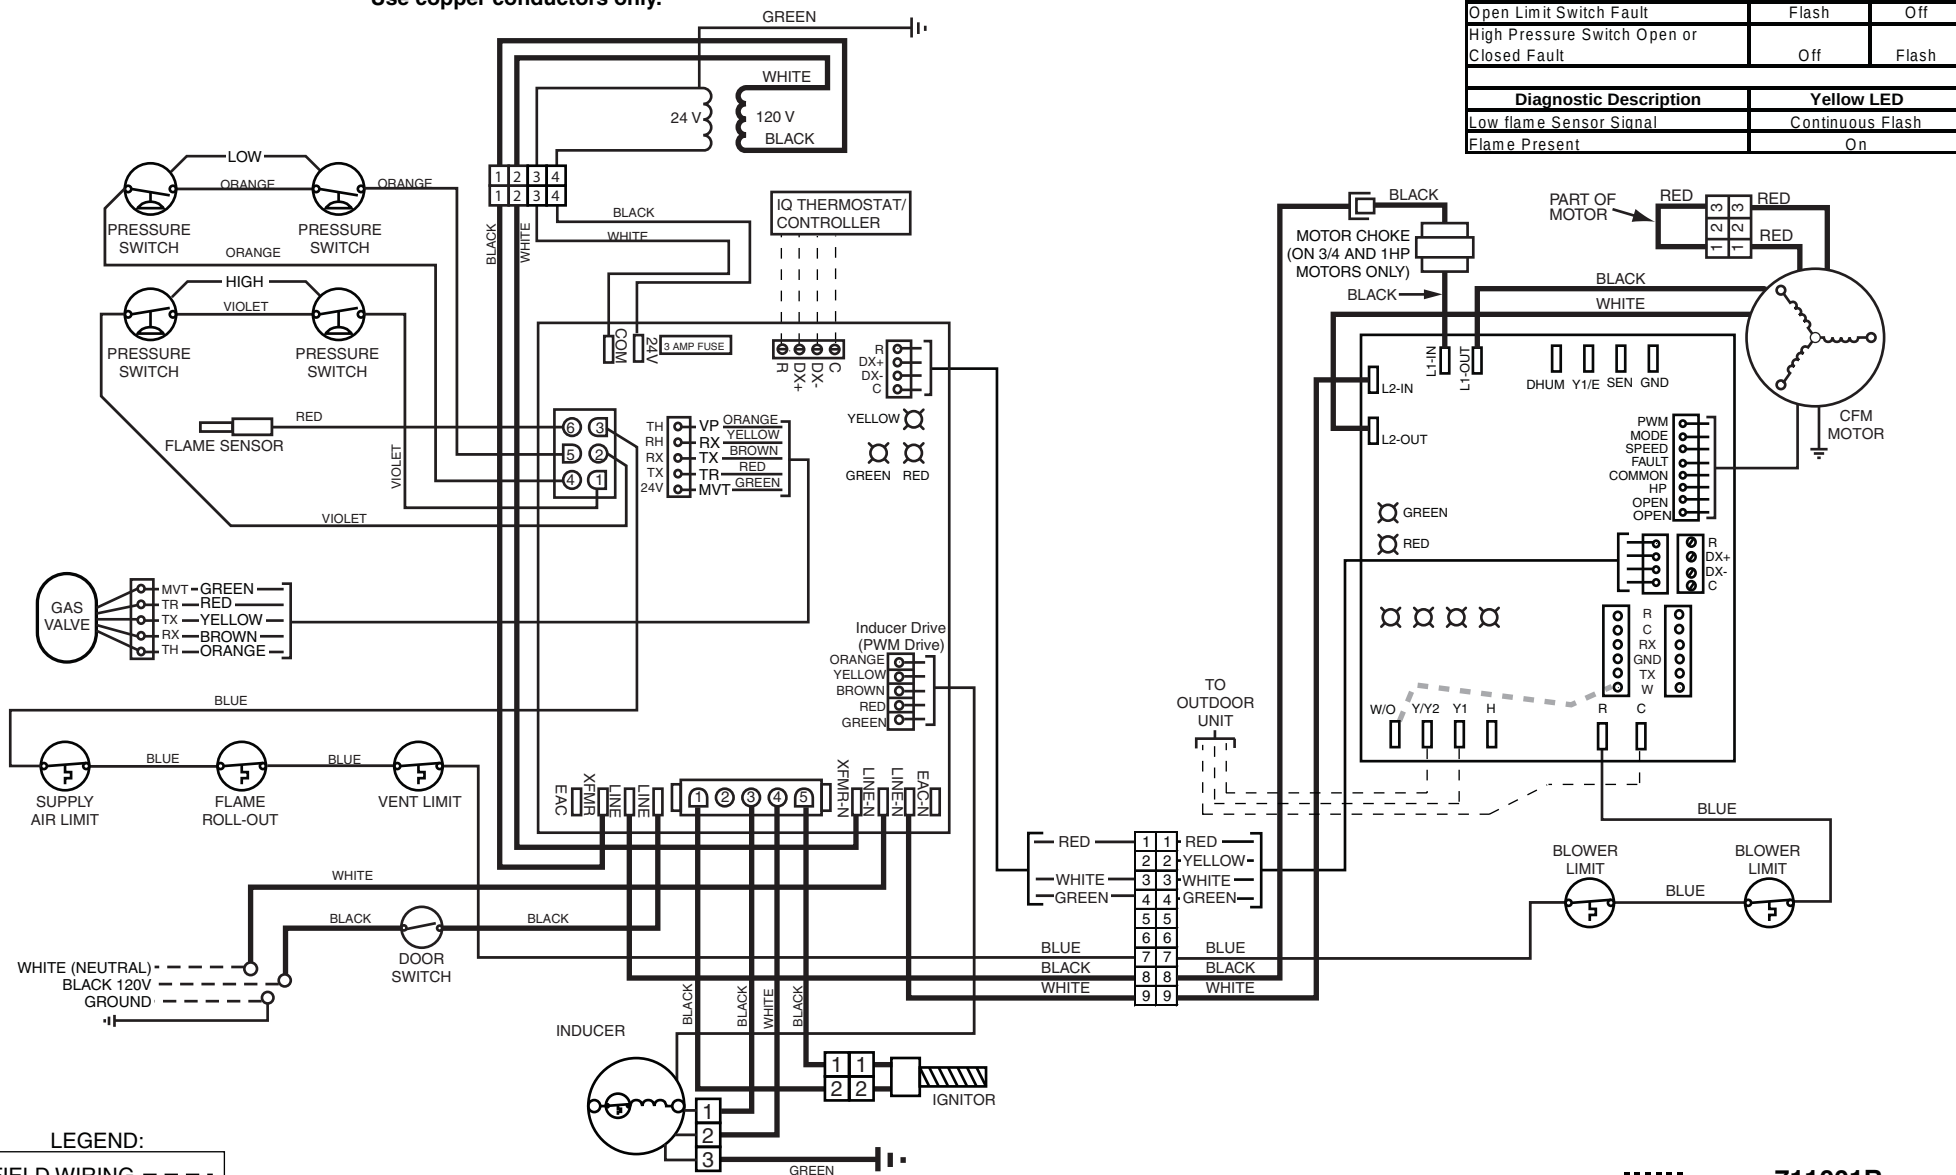

711001B
(Replaces 711001A)

04/11

