

HEAT PUMP JOBSITE INFORMATION SHEET

SERVICING CONTRACTOR:

DATE: _____

Name: _____
Street: _____
City: _____ Zip: _____
State/Province: _____ Phone: _____
Contact: _____

Call Ticket number _____

DISTRIBUTOR:Name: _____ State/Province: _____
Street: _____ Phone: _____
City: _____ Zip: _____ Contact: _____**EQUIPMENT DATA:**

OUTDOOR UNIT(Mirco-Channel or Fin/Tube)

Model #: _____ Serial #: _____ Date Installed: _____

EVAPORATOR (Micro-Channel or Fin/Tube)

Model #: _____ Serial #: _____ Date Installed: _____

AIR HANDLER (Micro-Channel or Fin/Tube)

Model #: _____ Serial #: _____ Date Installed: _____

FURNACE

Model #: _____ Serial #: _____ Date Installed: _____

Type of Thermostat: _____

PROBLEM SUMMARY:

DISCRIPTION OF TROUBLESHOOTING TO THIS POINT:

ACCESSORIES INSTALLED

- | | |
|---|---|
| <input type="checkbox"/> Mild Weather Kit | <input type="checkbox"/> High Pressure Switch |
| <input type="checkbox"/> Hard Start Kit | <input type="checkbox"/> Low Pressure Switch |
| <input type="checkbox"/> Hot Gas Bypass | |



HEAT PUMP JOBSITE SHEET

REMEMBER:

1. Circle Metering device used.
2. Circle Yes or No at drier locations.
3. Sat. Temp. is pressure converted to Temp.

Circle One

Heat Mode

Cool Mode

Saturation Temp.

Saturation Temp.


Low side PSIG

High side PSIG

Inside Temp. Leaving

DB: _____


WB: _____

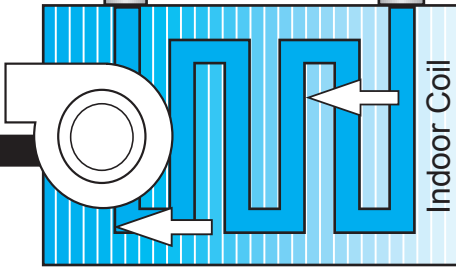

DB: _____

WB: _____

Circle one: Upflow - Downflow - Horizontal

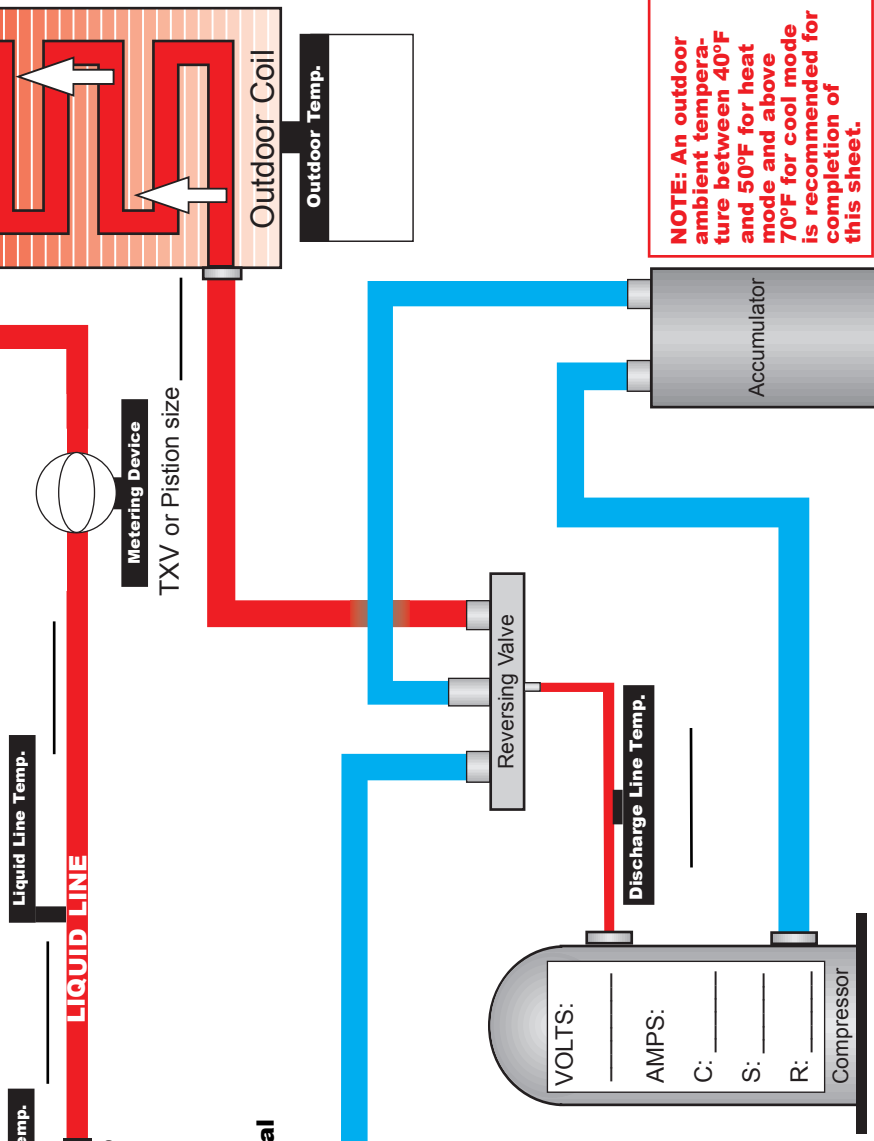

Formula For Super Heat

Vapor Line Temp. _____

Minus Sat Temp. _____

Equals Super Heat _____

Formula For Sub Cooling

Sat Temp. _____

Minus Liquid Line Temp. _____

Equals Sub Cooling _____

NOTE: An outdoor ambient temperature between 40°F and 50°F for heat mode and above 70°F for cool mode is recommended for completion of this sheet.

1. Liquid Line Size: _____
2. Liquid Line Length Vertical/Horizontal: _____
3. Vapor Line Size: _____
4. Vapor Line Length: Vertical/Horizontal: _____
5. Vertical Separation Below/Above: _____
6. Air Handler CFM: _____ Method Used for CFM: _____
7. Dipswitch Settings Cooling _____
8. Dipswitch Setting Heating _____